




Licross®

Schienen Anschlussraum mittig IP40  
Rail Terminal Compartment central IP40


59TL1CN0

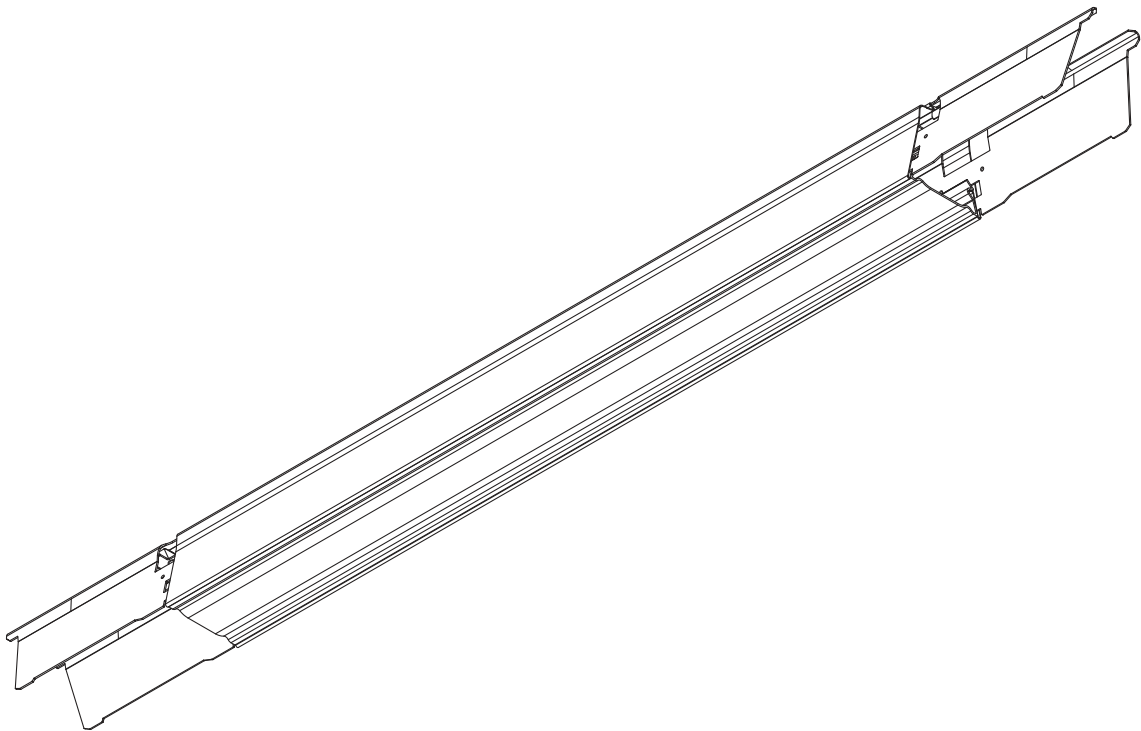


**siteco**

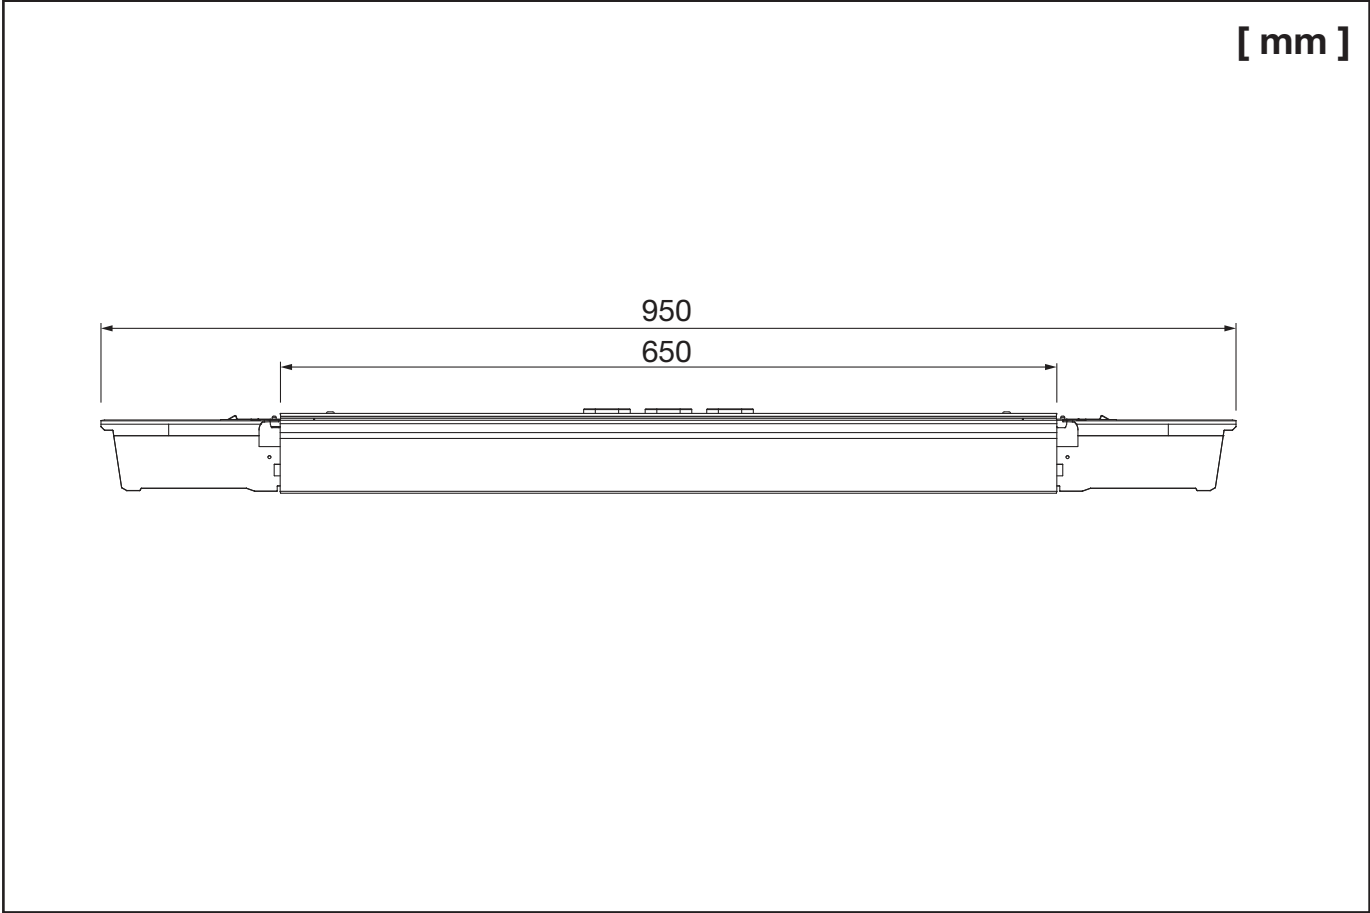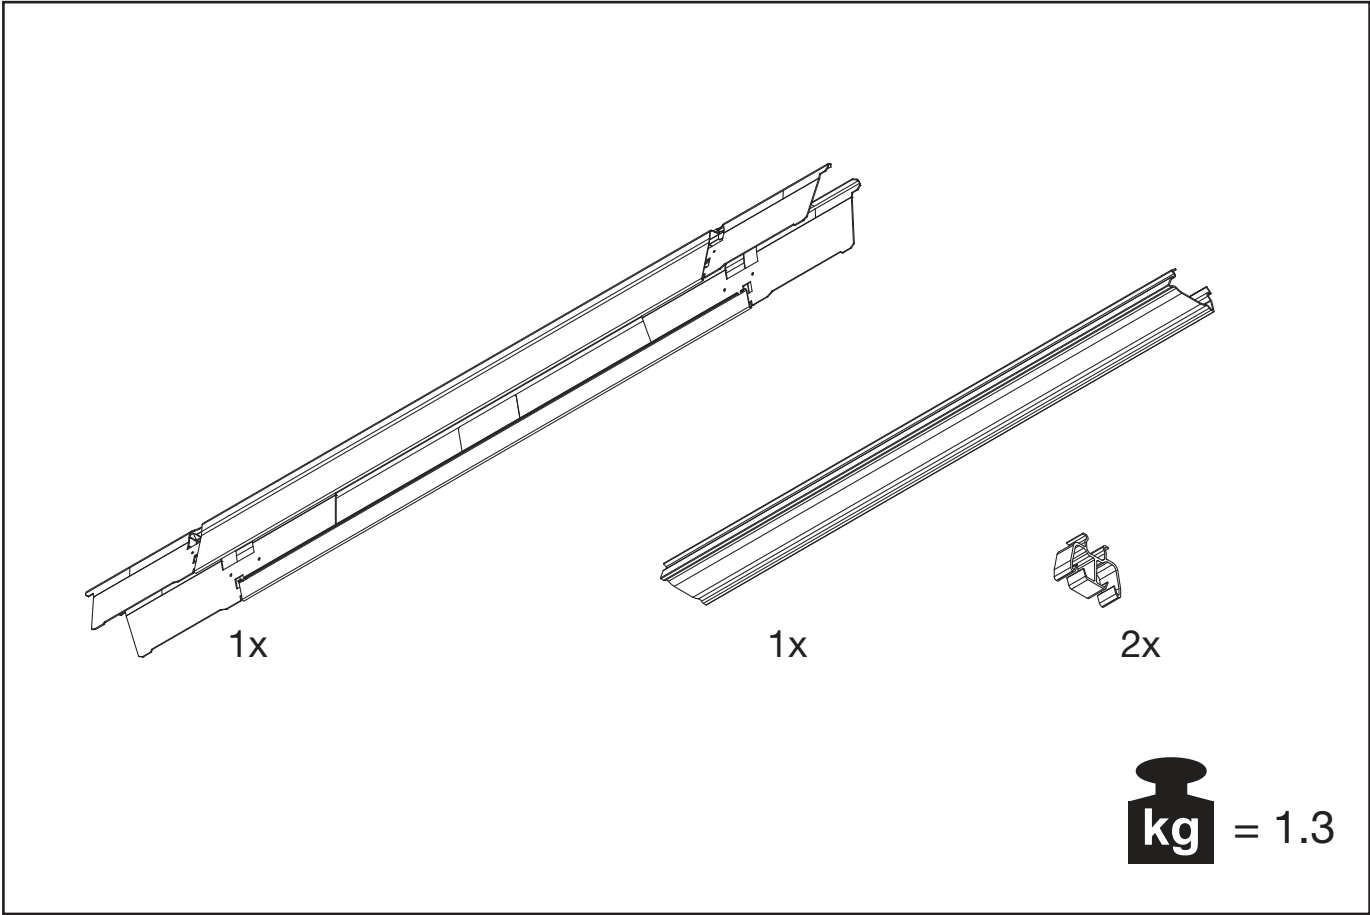


59TL3FNKFE →

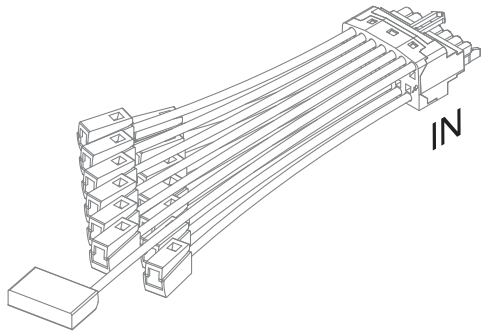


59TL3FTKFE →

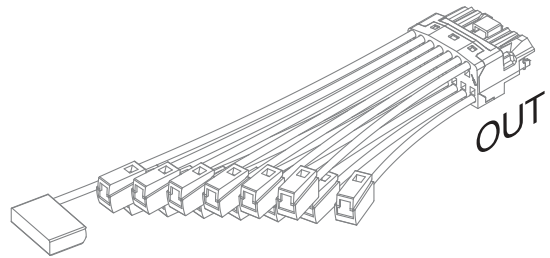



59TL3FNK →





59TL3FTK →

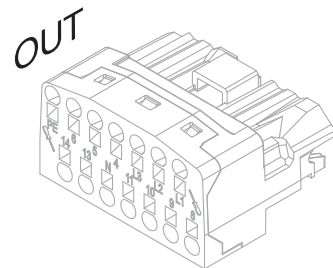




- 1** Umgebungstemperatur während der Installation: +5°C...+40°C  
Ambient temperature during installation:

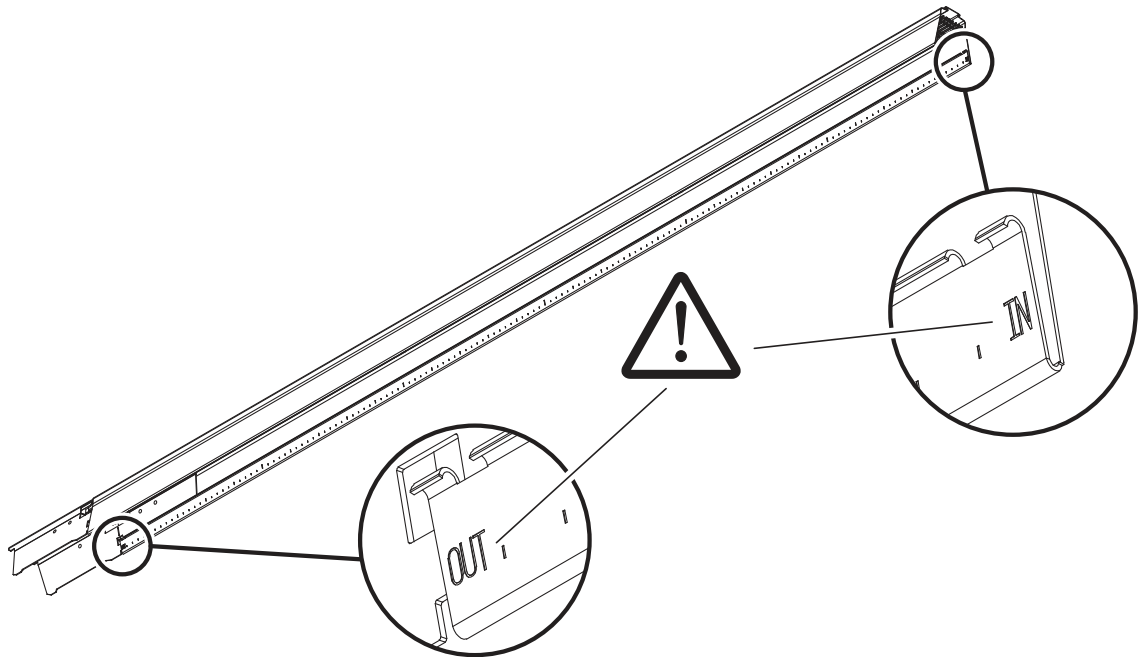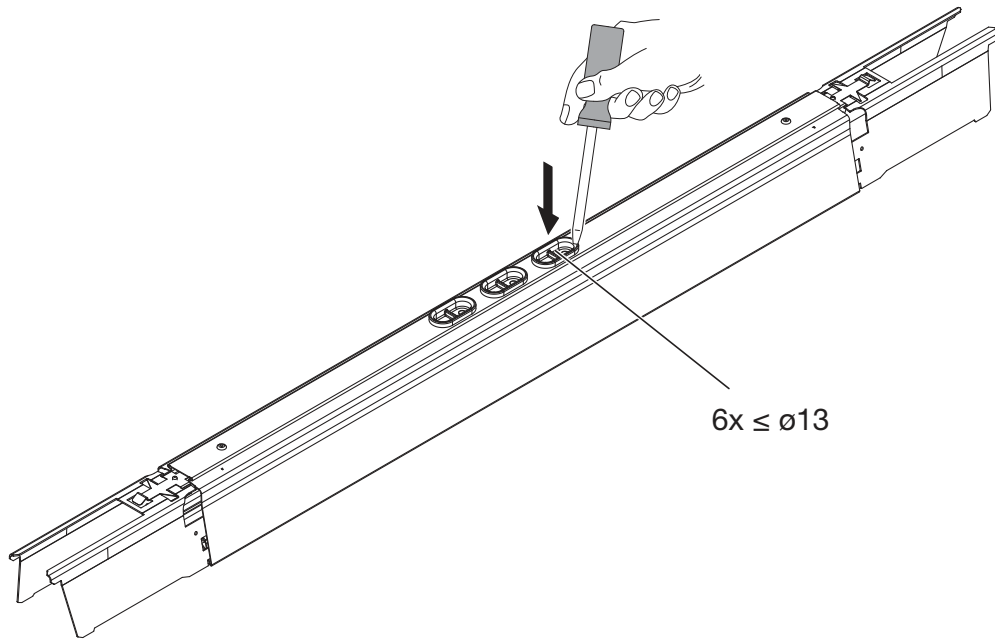

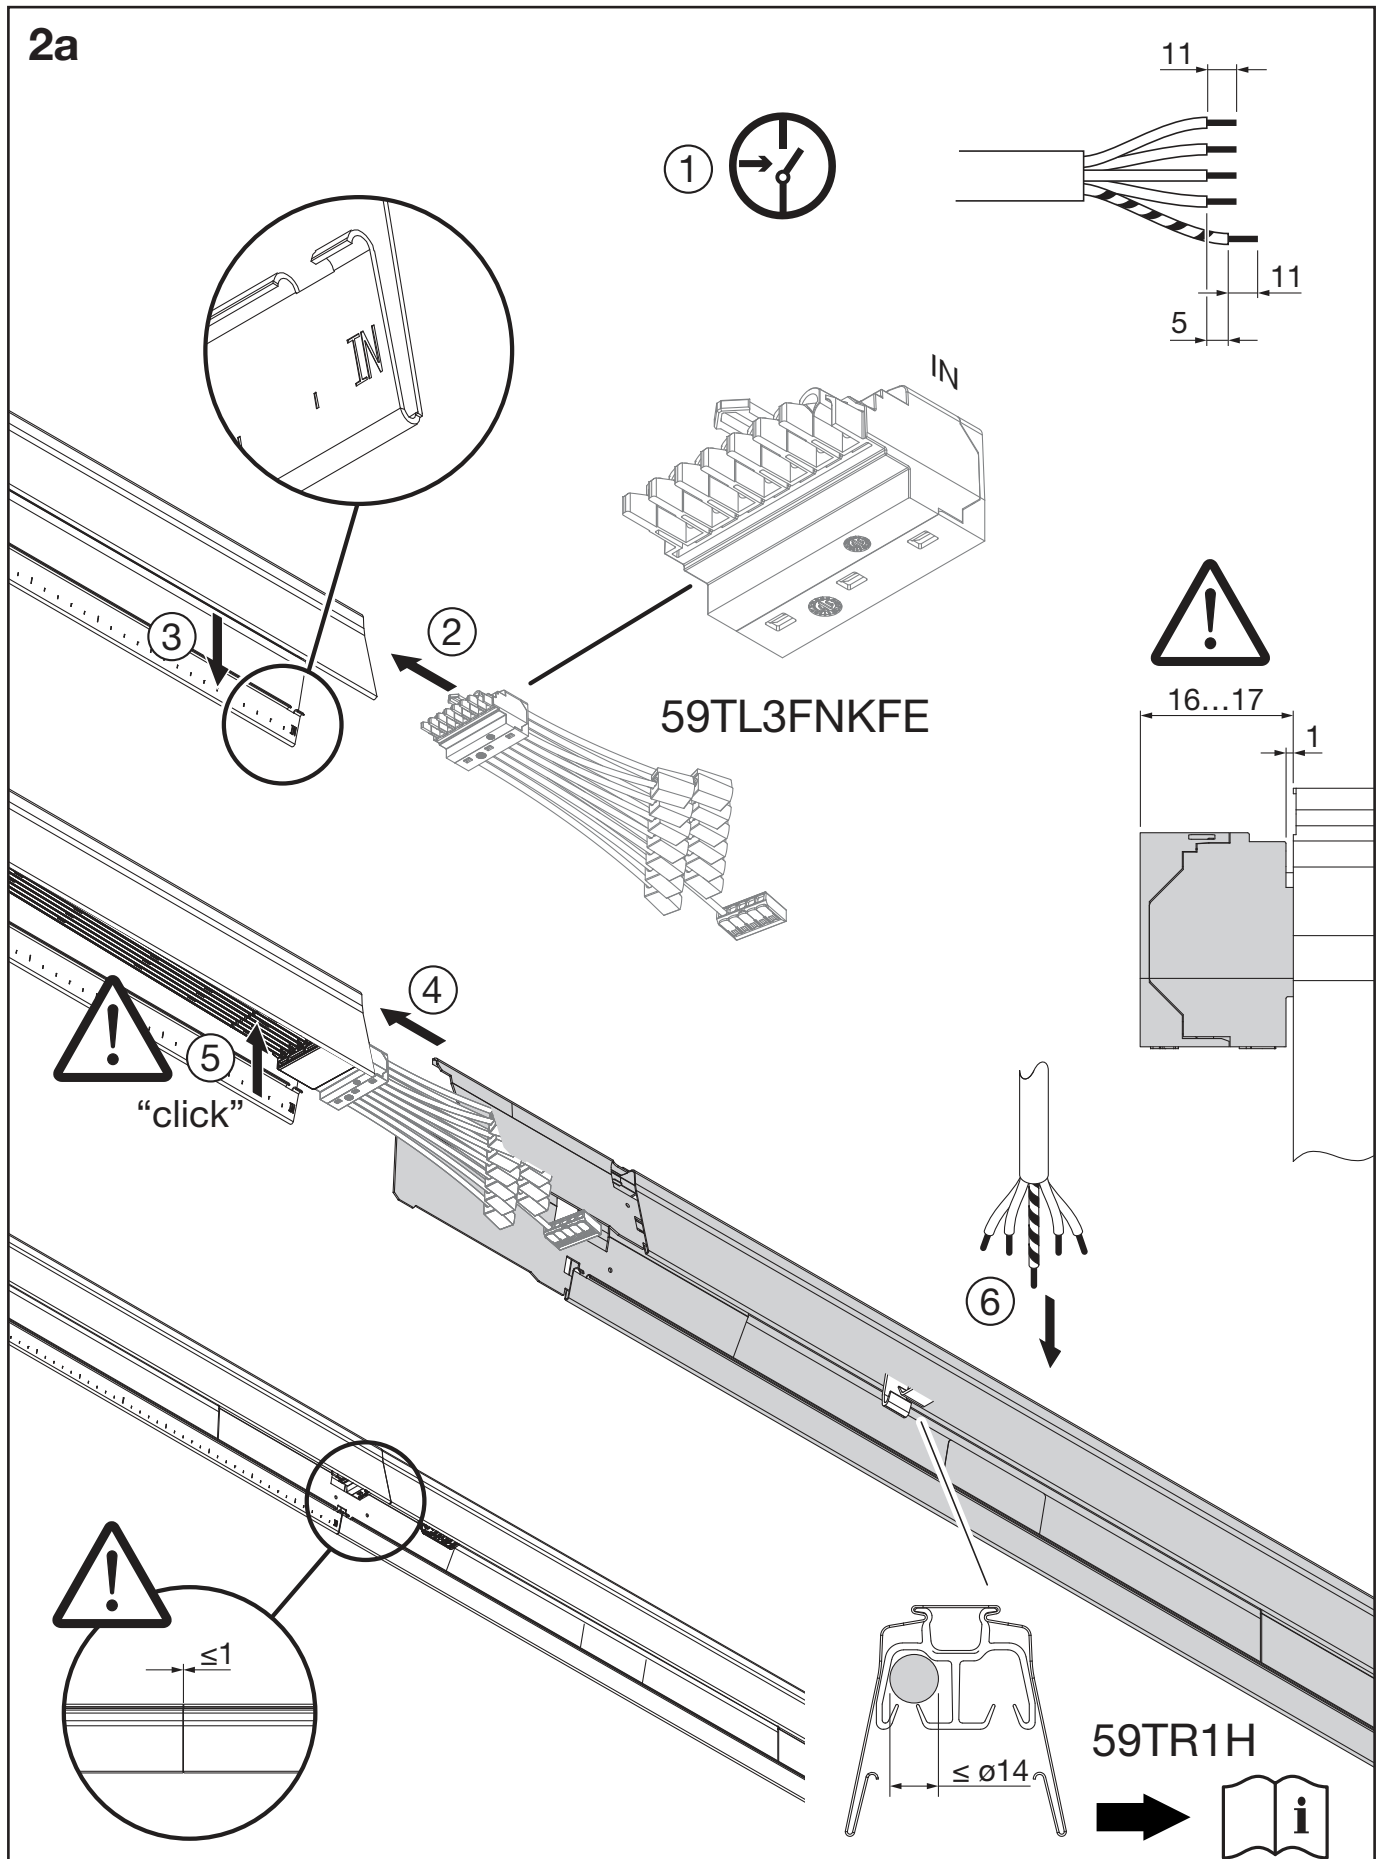

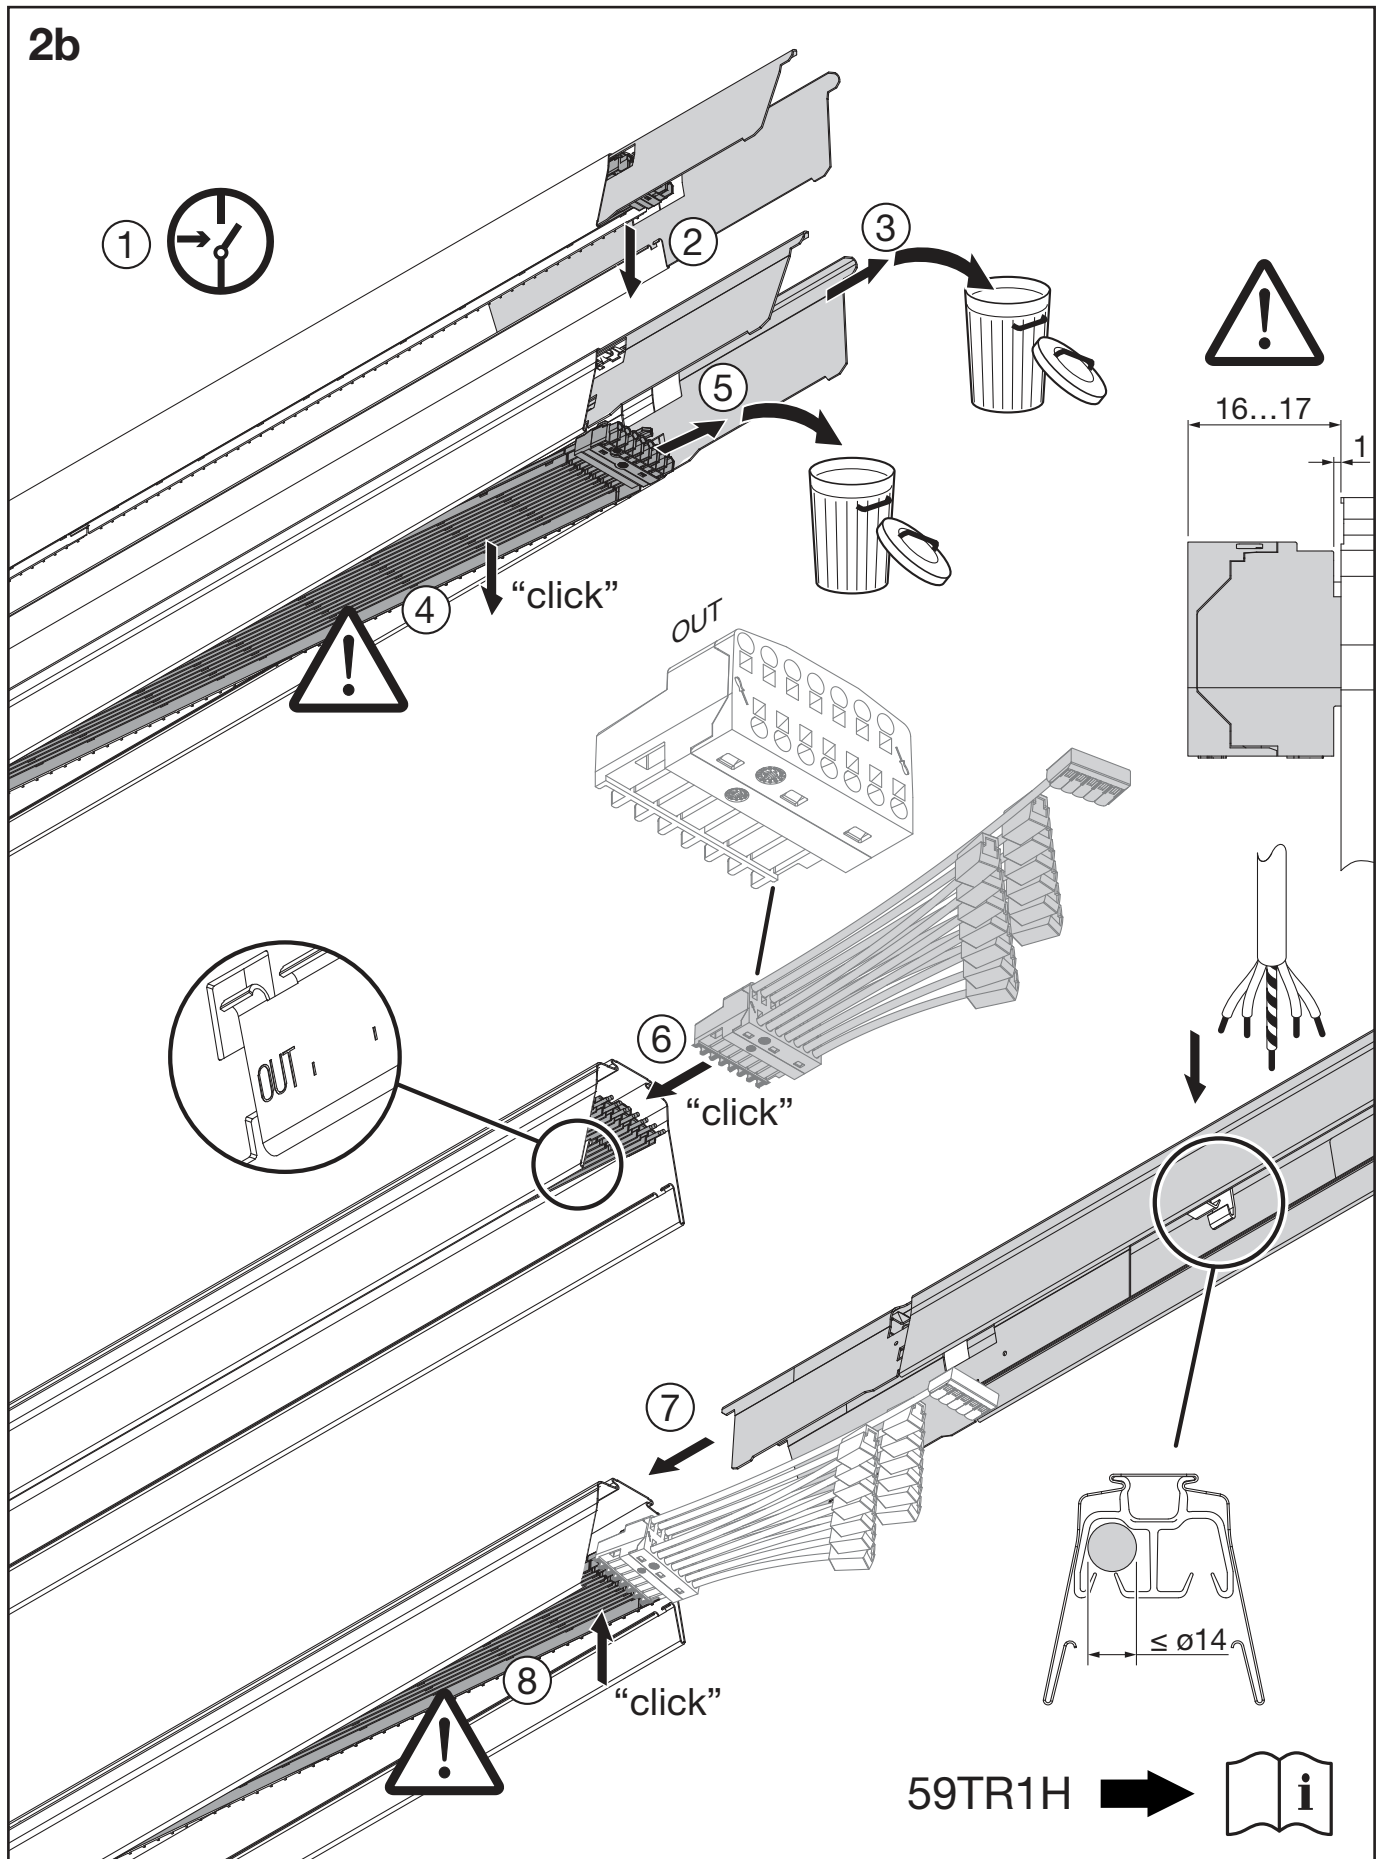

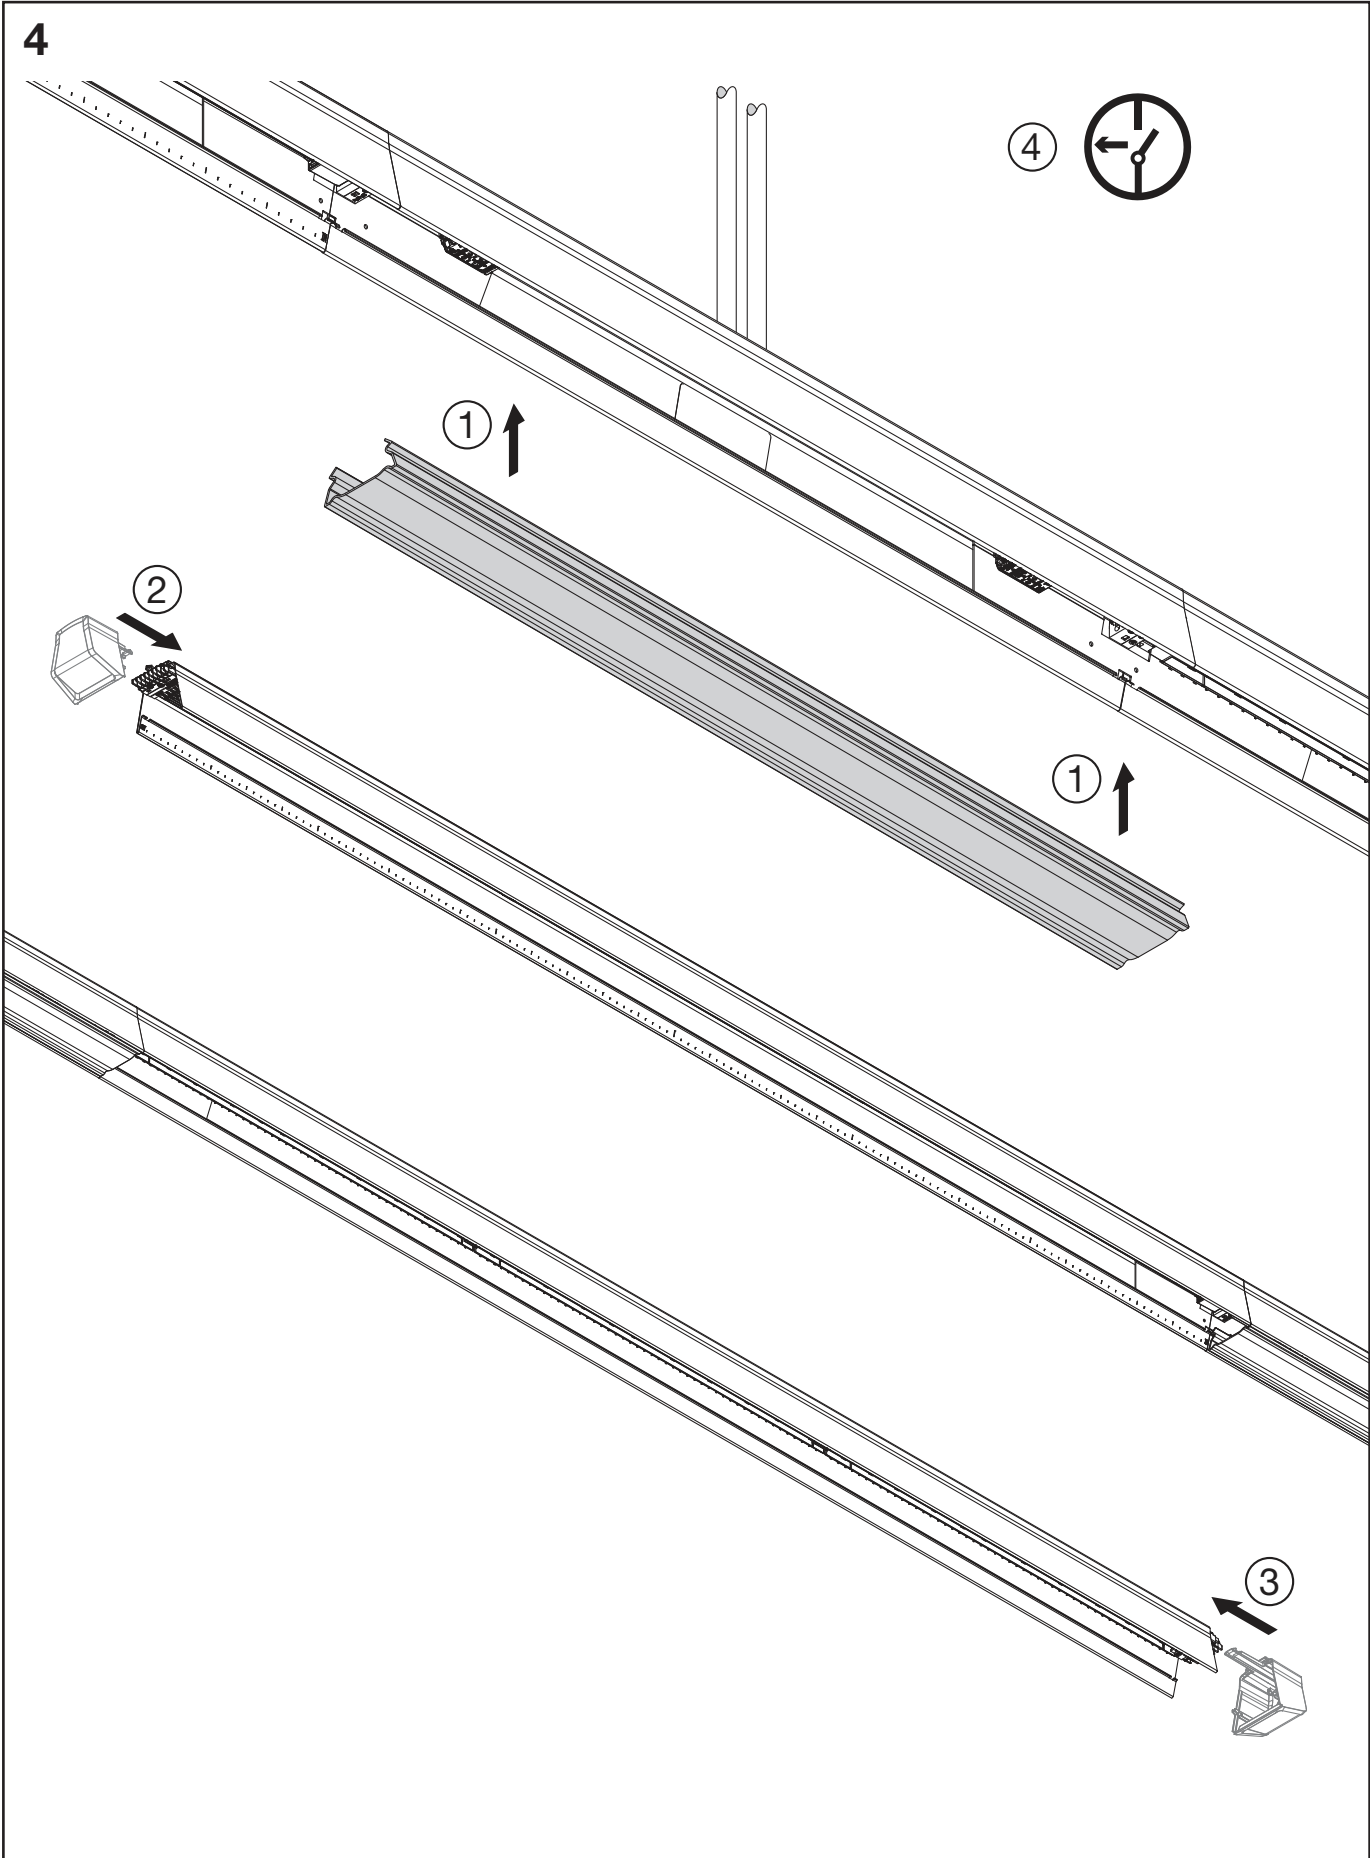

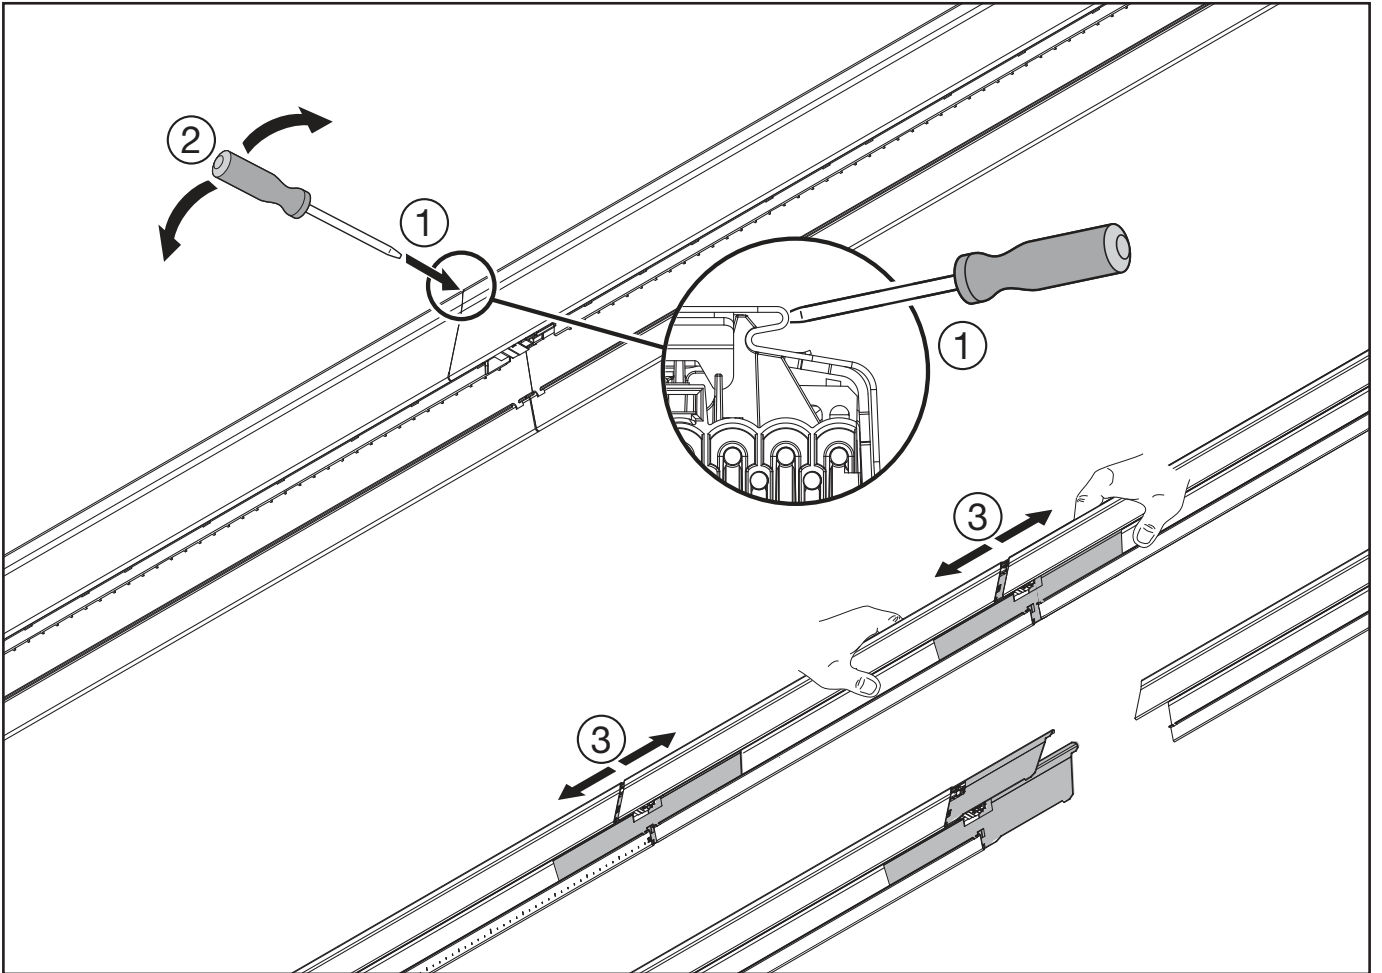

5MA14-266704\_aa  
20.12.2023 / AZ

Siteco GmbH  
Georg-Simon-Ohm-Straße 50  
83301 Traunreut, Germany  
mail: [technicalsupport@siteco.de](mailto:technicalsupport@siteco.de)  
Phone: +49 8669 / 33-844  
[www.siteco.com](http://www.siteco.com)