


Order No.: 59MX2BW000SA | GTIN (EAN): 4058352608845

Product description: Sil21,SensMoPR3S,lokCtrl,PIR-sens

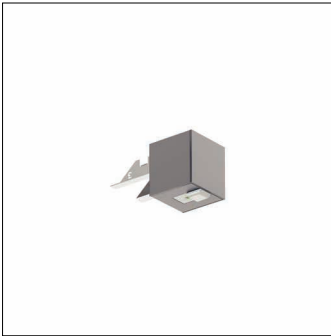


Silica® 21, sensor module PR3-S, slave,local control installation type: slip-in mounting, installation location: to the luminaire, of extruded aluminium section, protection rating (complete): IP20, insulation class (complete): insulation class I (protective earthing), certification: CE, 1 x PIR movement sensor, 1 x light sensor, packaging unit: 1 piece

IP 20  

Wt. (kg): 999.0
GTIN (EAN): 4058352608845

Order No.: 59MX2BW000SA | GTIN (EAN): 4058352608845

Detailed technical description: Sil21,SensMoPR3S,lokCtrl,PIR-sens

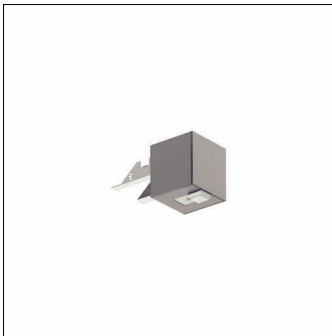

Key data

- System family: SITECO Connect Wireless
- Product type: lighting management components
- Product name: Silica® 21
- Order No.: 59MX2BW000SA

Lighting technology | Lamps | Control gear

Component 1

Operating device:

- Control: Bluetooth® mesh 4.2

Certificates, Standards

- Protection rating: IP20
- Insulation class: insulation class I (protective earthing)
- Temperature range (operation): 0..+40°C
- Certification, designation: CE

Material, Colour

- housing: extruded aluminium section, anodised, metallic grey (RAL 9006)
- Colour specification: metallic grey (RAL 9006)

Mounting

- Mounting method, mounting location: slip-in mounting, to the luminaire
- Mounting height: 2.5..5m
- Supplement: for surface-mounted luminaires, for pendant luminaires

Dimensions, Weight

- Width: 53mm
- Height: 53mm
- Weight: 999.0kg



Inputs

1x PIR movement sensor

- Connection: PIR sensor (passive-infrared)

Order No.: 59MX2BW000SA | GTIN (EAN): 4058352608845

Dimensions: Sil21,SensMoPR3S,lokCtrl,PIR-sens

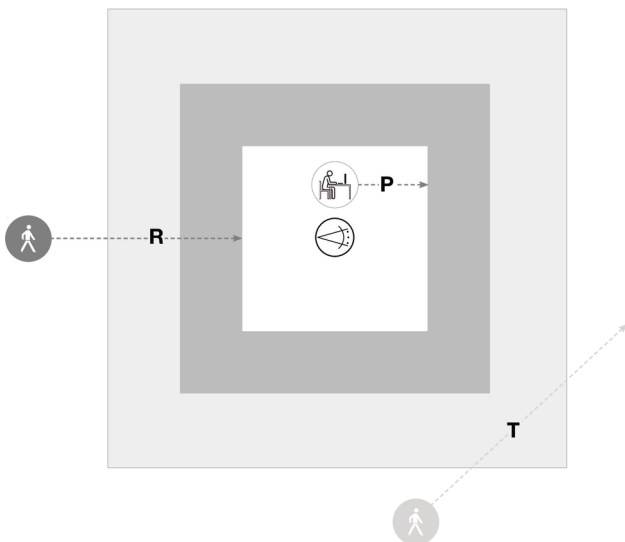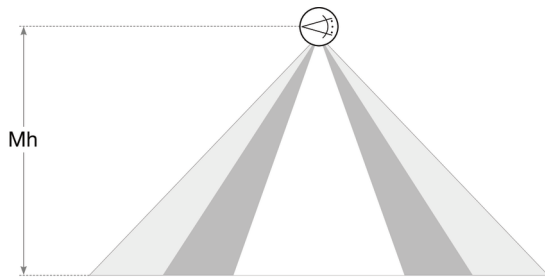

Sensor PR3

Mh	R	T	P
2,5m	ca. 3x3m	ca. 4x5m	ca. 2x2m
3,5m	ca. 4x4m	ca. 5x6m	ca. 3x3m

It is mandatory that the assembly instructions must be observed when planning and installing the electrical installation (to be found at www.siteco.de)
 Issued 20.03.2022 - Modifications and errors subject to change - Ensure that you always use the latest version -